

○ 3.66

67/14
c

TABLE OF CONTENTS

* * * *

1. Letter of transmittal
2. Discussion
3. Tabulations

* * * *

WAR RELOCATION AUTHORITY
Manzanar, California

May 21, 1942

FROM: Works Division
TO: Mr. Roy Nash, Project Director
SUBJECT: Transmittal of report on electrical system within
the barracks

Sir:

Attached is a report submitted by Mr. Robert Kubota.

I have been cognizant of the fact that electrical circuits in the barracks are greatly overloaded, ever since I have been here. But, I did not have concrete information as to the extent of the overload conditions.

A few weeks ago, Mr. Kubota, an electrical engineer, applied for work. I was impressed by Mr. Kubota's background, training, and intelligence and I engaged him. His first assignment was to survey electrical equipment within the apartments and loading conditions. The report, which Mr. Kubota has submitted, speaks for itself. I am writing Mr. Kubota a letter commending him on the excellent job he has done, the thoroughness of his investigation and presentation.

The electrical system in the barracks was designed for lighting loads, in other words, little thought was given to the fact that families were to live in the apartments; that food must be heated or prepared for babies on hot plates; or that electric irons would be used in the apartments. The overloading of these circuits constitutes a very hazardous condition. Whether the use of appliances must be controlled, or additional circuits must be installed in the buildings, is something that should be decided at once.

I am also attaching a letter I am writing Mr. Kubota.

Sincerely,

Ralph S. Brooks
Ralph S. Brooks

RSB/li
Att.

SURVEY OF ELECTRICAL SYSTEM
WITHIN
BARRACK BUILDINGS

* * * * *

SUBMITTED BY
WORKS DIVISION

* * * * *

WAR RELOCATION AUTHORITY
MANZANAR, CALIFORNIA

PREPARED BY:
ROBERT A. KUBOTA

This survey and report on the size of fuses used, and the amount, type, condition, and placement of extension cords, were made under the direction of Mr. Fiel of the Fire Department.

A survey was made on all apartments occupied by families who have been here longer than one week. The survey shows that a very great fire hazard exists from the use of heavy appliances connected to extension cords. Some thing must be done to eliminate this fire hazard.

The apartments are equipped with 20 or 30 ampere fuses. There were no pennies found in any of the fuses. Thirty four percent of all the buildings have had at least one fuse blown out since occupancy. Of this, ten and a half percent have had two or more, and as high as six. This clearly indicates an overloading of the lines. It was found that many heavy appliances would cause the extension cords to heat up to a point where the rubber insulation would slowly deteriorate.

There were nearly 5½ miles of different type of extension wires found in 985 apartments. The amount of poor wire (deteriorated or frayed) was very small; 47 cases out of 985, or a percentage of 4-3/4%. The amount of fair wire (not frayed or deteriorated, but taped in many places) was 88 cases out of 985, or a percentage of 8½%. This shows that the people are using good wire, but being under heavy loads, will deteriorate very quickly.

In most cases, the heavy appliances, such as electric irons and hot plates, are an absolute necessity. Fire hazards would be eliminated to a great extent if these heavy appliances could be used directly off the main line without the use of extension cords. This is not possible in many cases, due to the short length of wire attached to the appliances. The best solution to this problem would be to install heavily wired utility plug-in-boxes on the walls of the apartments. All extension cords should be limited to 4 feet or less, and to be used only on light appliances (200 watt or less) and light bulbs. The heavy appliances should go directly to the utility plug-in-boxes.

A method must be devised so that fuse blow-outs will be decreased. There have been no pennies found as yet, but with the lack of extra fuses, some people will start to use them.

It may be well to regulate the use of electrical appliances in each apartment, or install ironing boards in the laundry rooms. The electric stove situation will be a little harder to regulate, but some method should be devised, or the size (wattage) of the electric stoves be limited.

These fire hazards should be checked as soon as possible by one or more methods before there is any loss of life and property.

The following pages show the data taken on this survey.

Chart Designations

Column 1.	Block number
Column 2.	Building number
Column 3.	Apartment number
Column 4.	Fuse size
Column 5.	Number of feet of extension wire in each apartment
Column 6.	RC--rubber-covered rip cord GC--green or black twisted cloth-covered cord VC--vacumn cleaner cord CC--cotton-covered cord
Column 7.	G--good F--fair, not frayed or deteriorated but taped or joined in places. P--Poor, wire that is frayed or deteriorated
Column 8.	N--wire hooked over nails or nailed to rafters or sides of walls H--wire strung over rafters or suspended from rafters by string or rope S--insulated staples I--wires on insulators
Column 9.	FO indicates fuse blow-outs and the number following indicates number of times fuse has blown out.

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks
-------	-------	------	-----------	----------------	--------------	-------------------	-----------	---------

3

1
2
3
4
5
6
7

8	1	20	20	CC	G	N	
8	2	20	--				
8	3	20	15	RC	G	N	
8	4	20	10	GC	G	N	

9	1	20	25	CC RC	G	H	
9	2	20	--				
9	3	20	10	RC	G	H	
9	4	20	30	RC	G	H	

10	1	30	70	CC RC	G	N	
10	2	30	5	CC	F	H	
10	3	30	30	RC	G	H	
10	4	30	30	RC	G	H	

11	1	20	100	RC CC	G	N	FO-4
11	2	20	30	CC	G	N	
11	3	20	35	GC CC	G	N	
11	4	20	50	RC	G	N	

12	1	20	10	RC	G	H	
12	2	20	--				
12	3	20	30	GC	G	H	
12	4	20	--				

13	1	30	30	RC	G	H	FO-1
13	2	30	10	GC	G	H	
13	3	30	5	GC	G	N	
13	4	30	50	RC CC	G	I	

14		20	--				
				595	Total ft. wire		

4

1	1	20	15	RC	P	N	
1	2	20	20	RC	G	H	
1	3	20	10	GC	G	N	
1	4	20	--				

2	1	30	--				FO-1
2	2	30	15	RC	F	N	
2	3	30	10	RC	G	H	
2	4	30	--				

3	1	20	20	RC CC	G	H	FO-2
3	2	20	60	RC	G	H	
3	3	20	40	RC CC	G	N	
3	4	20	45	RC CC	G	H	

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks
4	4	1	30	35	RC	P	N	FO-1
	4	2	30	15	RC	G	N	
	4	3	30	--				
	4	4	30	30	RC	G	N	
	5	1	20	--				FO-1
	5	2	20	25	RC	G	N	
	5	3	20	--				
	5	4	20	22	RC	G	H	
	6	1	20	8	RC	P	N	
	6	2	20	12	RC CC	G	H	
	6	3	20	30	RC CC	G	H	
	6	4	20	60	RC CC	G	H	
	7	1	20	10	CC	G	H	FO-1
	7	2	20	36	RC CC	G	N	
	7	3	20	36	RC CC	F	N	
	7	4	20	32	RC	G	H	
	8	1	30	30	RC GC	G	H	
	8	2	30	40	RC GC	G	H	
	8	3	30	60	RC CC	G	NS	
	8	4	30	45	RC GC	G	H	
	9	1	30	40	GC CC	G	H	FO-1
	9	2	30	10	CC	G	H	
	9	3	30	35	RC CC	G	H	
	9	4	30	35	CC	F	N	
	10	1	20	20	RC	G	H	
	10	2	20	20	RC	G	H	
	10	3	20	25	RC CC	G	N	
	10	4	20	85	RC CC	F	N	
	11	1	20	15	RC	G	N	
	11	2	20	25	CC	G	N	
	11	3	20	6	GC	F	H	
	11	4	20	35	CC GC	F	H	
	12	1	20	12	GC	G	N	
	12	2	20	--				
	12	3	20	12	RC	F	H	
	12	4	20	30	CC RC	G	N	
	13	1	20	--				
	13	2	20	15	RC	G	N	
	13	3	20	60	RC GC	F	H	
	13	4	20	--				
14			20	60	GC RC	G	N	

1301 Total ft. wire

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks
5	1	1	20	12	RC	G	H	
	1	2	20	30	RC CC	F	N	
	1	3	20	65	RC CC	P	N	
	1	4	20	--				
	2	1	30	12	RC	G	N	FO-1
	2	2	30	60	CC	P	N	
	2	3	30	70	GC CC	G	H	
	2	4	30	35	RC GC	G	H	
	3	1	20	20	GC	G	N	
	3	2	20	45	CC RC	G	N	
	3	3	20	20	RC	G	N	
	3	4	20	40	RC CC	F	N	
	4	1	30	35	GC RC	G	N	FO-3
	4	2	30	20	RC	G	H	
	4	3	30	70	RC GC	G	N	
	4	4	30	12	RC	F	N	
	5	1	20	20	RC	G	H	
	5	2	20	12	RC	G	H	
	5	3	20	--				
	5	4	20	15	RC	G	H	
	6	1	20	25	RC GC	G	H	
	6	2	20	25	RC CC	G	N	
	6	3	20	35	GC	F	N	
	6	4	20	--				
	7	1	20	--				
	7	2	20	15	GC	F	H	
	7	3	20	35	RC	G	N	
	7	4	20	30	CC	G	N	
	8	1	20	20	GC	G	N	
	8	2	20	--				
	8	3	20	35	GC RC	G	N	
	8	4	20	40	CC	G	H	
	9	1	20	25	CC GC	G	H	
	9	2	20	20	CC GC	G	H	
	9	3	20	10	CC	G	H	
	9	4	20	25	CC	G	N	
	10	1	20	15	RC	G	H	
	10	2	20	10	CC	G	H	
	10	3	20	30	RC	P	H	
	10	4	20	8	CC	G	H	
	11	1	30	16	CC	G	H	FO-3
	11	2	30	--				
	11	3	30	8	CC	G	H	
	11	4	30	10	CC	G	H	

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks
-------	-------	------	-----------	----------------	--------------	-------------------	-----------	---------

5	12	1	20	20	RC	G	H	
	12	2	20	--				
	12	3	20	30	RC	G	N	
	12	4	20	25	RC	G	H	
	13	1	20	20	CC GC	G	H	
	13	2	20	15	RC	G	H	
	13	3	20	15	RC	G	H	
	13	4	20	70	RC GC	G	N	
	14		20	--				

1225 Total ft. wire

6	1	1	20	35	GC CC	F	N	
	1	2	20	--				
	1	3	20	50	GC CC	G	H	
	1	4	20	20	RC CC	G	N	
	2	1	30	25	RC	G	N	FO-2
	2	2	30	15	RC	G	H	
	2	3	30	20	GC	P	N	
	2	4	30	--				
	3	1	20	8	GC	G	N	FO-1
	3	2	20	--				
	3	3	20	55	GC RC	F	N	
	3	4	20	20	GC	F	N	
	4	1	30	40	CC	F	H	FO-1
	4	2	30	25	GC	F	H	
	4	3	30	50	CC	F	H	
	4	4	30	25	RC	G	N	
	5	1	30	60	CC RC	G	H	FO-2
	5	2	30	20	RC	G	N	
	5	3	30	40	RC	G	S	
	5	4	30	50	CC RC	F	S	
	6	1	30	35	RC GC	G	N	FO-3
	6	2	30	20	RC	G	N	
	6	3	30	20	GC RC	G	H	
	6	4	30	15	RC	G	H	
	7	1	30	60	RC GC	G	H	FO-1
	7	2	30	40	RC GC	F	H	
	7	3	30	15	RC	G	H	
	7	4	30	--				
	8	1	20	45	RC	G	N	
	8	2	20	20	CC RC	G	H	
	8	3	20	30	CC	P	H	
	8	4	20	50	RC	G	N	
	9	1	30	20	RC GC	G	H	FO-2
	9	2	30	15	RC	G	H	
	9	3	30	45	RC GC	G	H	
	9	4	30	35	RC	F	N	

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks	
6	10	1	30	15	CC	G	N	FO-2	
	10	2	30	8	RC	G	H		
	10	3	30	20	CC	G	H		
	10	4	30	30	RC	F	N		
	11	1	30	60	CC RC	G	H	FO-1	
	11	2	30	45	RC	G	H		
	11	3	30	50	RC	G	S		
	11	4	30	10	GC	G	H		
	12	1	30	--				FO-6	
	12	2	30	10	GC	G	H		
	12	3	30	50	CC	G	H		
	12	4	30	10	RC	G	H		
	13	1	30	25	RC	G	H	FO-1	
	13	2	30	5	RC	G	H		
	13	3	30	25	RC CC	G	N		
	13	4	30	25	GC	G	H		
	14		20	--					
	1411 Total ft. wire								
	7	1-4	Office use						
5		1	20	36	RC CC	G	H		
5		2	20	15	CC RC	G	H		
5		3	20	--					
5		4	20	--					
6-7		Empty							
8-13		Hospital use							
14		Empty							
51 Total ft. wire									
8		1	1	20	16	RC CC	G	H	
		1	2	20	25	RC GC	F	N	
		1	3	20	60	GC	G	H	
		1	4	20	--				
		2	1	20	35	RC CC	G	N	
	2	2	20	--					
	2	3	20	35	CC	G	SH		
	2	4	20	35	CC	G	H		
	3	1	20	6	RC	G	H		
	3	2	20	30	GC RC	G	H		
	3	3	20	25	RC CC	G	H		
	3	4	20	50	CC	G	H		

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks	
8	4	1	20	30	CC	GC CC	P	N	
	4	2	20	30		GC RC	G	H	
	4	3	20	20		GC	G	H	
	4	4	20	55		CC RC	F	N	
	5	1	20	25		RC CC	G	H	
	5	2	20	25		RC	G	N	
	5	3	20	10		CC	G	N	
	5	4	20	20		RC	G	H	
	6	1	20	40		CC GC	F	N	FO-1
	6	2	20	30		RC	G	H	
	6	3	20	50		RC	G	N	
	6	4	20	20		CC GC	G	H	
	7	1	20	12		CC	G	H	
	7	2	20	30		CC RC	G	N	
	7	3	20	35		CC GC	G	H	
	7	4	20	50		RC CC	G	N	
	8	1	20	25		RC CC	G	N	
	8	2	20	--					
	8	3	20	10		CC	G	H	
	8	4	20	20		RC	G	H	
	9	1	30	25		GC CC	G	N	
	9	2	30	45		RC CC	G	H	
	9	3	30	20		RC	G	N	
	9	4	30	15		GC	G	H	
	10	1	20	35		GC RC	F	H	
	10	2	20	50		RC CC	G	H	
	10	3	20	35		VC CC	G	N	
	10	4	20	20		CC CC	P	H	
	11	1	20	30		RC GC	G	H	
	11	2	20	40		RC CC	G	H	
	11	3	20	40		RC CC	G	H	
	11	4	20	20		CC RC	G	H	
	12	1	20	22		RC CC	G	S	
	12	2	20	20		RC	G	N	
	12	3	20	10		CC	F	H	
	12	4	20	30		RC GC	G	H	
	13	1	20	30		CC	G	H	
	13	2	20	35		CC RC	F	N	
	13	3	20	15		GC	G	H	
	13	4	20	--					
	14		Empty						

1391 Total ft. wire

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of Cord	Condition of cord	How wired	Remarks
9	1	1	20	12	RC	G	N	
	2	2	20	25	CC RC	G	H	
	1	3	20	40	CC	G	H	
	1	4	20	40	GC RC	G	N	
	2	1	20	45	RC CC	G	N	FO-1
	2	2	20	35	GC CC	G	H	
	2	3	20	20	GC	G	S	
	2	4	20	25	RC CC	G	N	
	3	1	30	20	RC	G	H	FO-2
	3	2	30	15	GC	G	N	
	3	3	30	15	GC	F	H	
	3	4	30	55	GC CC	G	H	
	4	1	30	35	RC CC	G	N	
	4	2	30	40	GC	G	N	
	4	3	30	40	CC RC	G	N	
	4	4	30	35	RC GC	G	I	
	5	1	30	--				FO-2
	5	2	30	30	GC CC	G	H	
	5	3	30	40	GC RC	F	N	
	5	4	30	35	CC	G	N	
	6	1	20	40	GC CC	G	H	FO-1
	6	2	20	20	CC	F	H	
	6	3	20	40	RC CC	G	H	
	6	4	20	25	CC RC	G	H	
	7	1	30	25	GC	G	H	
	7	2	30	--				
	7	3	30	35	RC CC	G	N	
	7	4	30	25	GC RC	G	H	
	8	1	20	50	RC GC	G	N	
	8	2	20	35	CC RC	G	N	
	8	3	20	15	RC	G	N	
	8	4	20	10	RC	G	H	
	9	1	30	50	CC	F	H	FO-2
	9	2	30	30	RC CC	G	H	
	9	3	30	15	GC	G	N	
	9	4	30	50	RC	G	H	
	10	1	30	40	RC CC	F	H	
	10	2	30	--				
	10	3	30	45	RC GC	G	H	
	10	4	30	20	RC CC	F	H	
	11	1	20	65	RC CC	F	N	FO-1
	11	2	20	40	RC GC	G	H	
	11	3	20	45	GC CC	P	N	
	11	4	20	30	GC CC	G	N	

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks	
9	12	1	20	15	CC	G	H	FO-1	
	12	2	20	50	RC	G	H		
	12	3	20	12	CC	G	H		
	12	4	20	55	RC GC	G	H		
	13	1	20	60	RC CC	G	H	HS	
	13	2	20	75	RC CC	G	HS		
	13	3	20	10	RC	G	H		
	13	4	20	70	RC GC	G	H		
	14		20	60	RC CC	G	H		
	1759 Total ft. wire								
	10	1	1	20	25	GC RC	G	H	FO-1
		1	2	20	20	RC CC	G	H	
		1	3	20	15	GC	G	H	
		1	4	20	--				
2		1	30	10	CC RC	G	H	FO-1	
2		2	30	55	RC	G	H		
2		3	30	20	RC	G	N		
2		4	30	40	CC RC	G	N		
3		1	20	50	GC CC	G	N	FO-2	
3		2	20	50	GC CC	G	N		
3		3	20	25	CC RC	G	N		
3		4	20	25	GC	G	N		
4		1	25	10	RC	G	N	FO-2	
4		2	25	45	CC RC	G	N		
4		3	25	35	CC GC	G	N		
4		4	25	30	RC	G	N		
5		1	30	30	GC CC	G	H	FO-1	
5		2	30	12	CC	G	H		
5		3	30	20	CC	G	N		
5		4	30	30	RC	G	H		
6		1	30	15	CC	G	H	FO-1	
6		2	30	25	CC	G	H		
6		3	30	12	CC	P	N		
6		4	30	30	RC	G	N		
7		1	20	30	RC	G	H	FO-1	
7		2	20	10	RC	G	H		
7		3	20	20	RC CC	G	N		
7		4	20	45	RC GC	F	N		
8		1	20	20	RC	G	N	FO-1	
8		2	20	30	GC RC	G	H		
8		3	20	25	CC	G	N		
8		4	20	Information office					
9		1	30	--					
9		2	30	50	RC	G	HS		

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks
19	9	3	30	--				
	9	4	30	20	CC	G	H	
	10	1	30	15	GC	G	H	FO-1
	10	2	30	40	CC GC	P	H	
	10	3	30	20	RC CC	G	H	
	10	4	30	40	GC RC	G	S	
	11	1	20	12	GC	G	N	
	11	2	20	10	CC	G	N	
	11	3	20	10	RC	G	H	
	11	4	20	40	RC CC	G	H	
	12	1	30	50	RC CC	G	H	FO-2
	12	2	30	5	RC	G	N	
	12	3	30	25	CC RC	G	H	
	12	4	30	50	CC RC	P	N	
	13	1	30	10	RC	G	H	
	13	2	30	65	CC RC	G	N	
	13	3	30	40	CC	G	N	
	13	4	30	35	GC CC	P	H	
	14		20	<u>40</u>	RC	G	N	
	1396 Total ft. wire							
11	1	1	20	25	RC CC	G	N	
	1	2	20	10	CC	F	H	
	1	3	20	40	RC CC	G	H	
	1	4	20	--				
	2	1	30	60	CC RC	P	H	FO-3
	2	2	30	10	CC	G	N	
	2	3	30	50	CC RC	G	H	
	2	4	30	35	RC	G	N	
	3	1	30	45	RC CC	F	H	FO-1
	3	2	30	30	GC RC	G	H	
	3	3	30	20	GC	G	H	
	3	4	30	10	RC	F	H	
	4	1	20	50	RC	G	H	
	4	2	20	60	GC CC	G	H	
	4	3	20	45	CC RC	F	H	
	4	4	20	15	RC	F	H	
	5	1	20	15	CC	P	H	
	5	2	20	12	RC CC	G	H	
	5	3	20	40	RC CC	G	N	
	5	4	20	--				

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks
11	6	1	30	30	CC RC	G	H	FO-1
	6	2	30	35	GC RC	F	H	
	6	3	30	20	RC	G	N	
	6	4	30	20	RC	G	N	
	7	1	30	50	CC GC	F	N	
	7	2	30	30	CC	G	N	
	7	3	30	18	RC	G	H	
	7	4	30	60	RC GC	G	N	
	8	1	30	50	RC GC	G	N	FO-1
	8	2	30	10	CC	G	H	
	8	3	30	---				
	8	4	30	---				
	9	1	20	20	RC CC	F	H	
	9	2	20	10	RC	G	H	
	9	3	20	12	RC	P	H	
	9	4	20	20	CC GC	G	N	
	10	1	20	20	CC	G	H	FO-1
	10	2	20	40	CC RC	G	N	
	10	3	20	30	CC GC	G	H	
	10	4	20	25	RC GC	G	N	
	11	1	20	45	RC CC	G	N	
	11	2	20	---				
	11	3	20	---				
	11	4	20	80	RC GC	P	N	
	12	1	20	10	RC	G	H	FO-1
	12	2	20	35	GC RC	G	H	
	12	3	20	100	RC CC	G	N	
	12	4	20	70	RC CC	P	H	
	13	1	20	40	RC	G	H	
	13	2	20	---				
	13	3	20	10	GC	G	H	
	13	4	20	45	CC GC	G	H	
14		20	Empty					
1507 Total ft. wire								
12	1	1	20	35	CC GC	F	H	
	1	2	20	15	CC	G	H	
	1	3	20	35	CC RC	G	N	
	1	4	20	25	CC	G	H	
	2	1	20	---				
	2	2	20	20	RC	G	H	
	2	3	20	20	RC	G	N	
	2	4	20	12	RC	G	N	

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks
12	3	1	30	50	GC RC	G	N	FO-1
	3	2	30	15	RC	G	N	
	3	3	30	60	GC RC	G	H	
	3	4	30	25	GC RC	G	N	
	4	1	20	20	RC	G	H	
	4	2	20	30	RC	G	H	
	4	3	20	25	CC	F	H	
	4	4	20	30	CC RC	F	N	
	5	1	20	20	RC	G	H	FO-1
	5	2	20	25	RC	G	H	
	5	3	20	50	GC RC	G	H	
	5	4	20	10	CC	G	H	
	6	1	20	25	CC GC	G	N	
	6	2	20	35	CC GC	G	N	
	6	3	20	40	CC GC	G	H	
	6	4	20	20	RC	G	H	
	7	1	30	60	RC GC	G	N	FO-2
	7	2	30	8	RC	G	H	
	7	3	30	40	CC RC	P	H	
	7	4	30	45	RC CC	G	H	
	8	1	20	10	CC	P	H	
	8	2	20	15	RC	G	N	
	8	3	20	20	RC	G	N	
	8	4	20	--				
	9	1	20	10	RC	G	H	
	9	2	20	20	RC	G	H	
	9	3	20	40	GC	G	N	
	9	4	20	40	GC RC	G	N	
	10	1	30	40	RC	G	H	FO-1
	10	2	30	30	RC CC	G	N	
	10	3	30	60	RC CC	G	H	
	10	4	30	15	GC	G	H	
	11	1	20	35	RC CC	G	N	
	11	2	20	25	RC GC	G	H	
	11	3	20	--				
	11	4	20	50	CC RC	F	H	
	12	1	30	60	CC RC	P	H	FO-1
	12	2	30	15	RC	G	H	
	12	3	30	25	RC GC	G	N	
	12	4	30	25	RC CC	P	H	
	13	1	20	50	GC CC	F	N	
	13	2	20	30	RC	G	N	
	13	3	20	55	RC GC	G	N	
	13	4	20	40	RC CC	G	N	

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks
12	14		20	<u>35</u>	RC GC	F	N	
1540 Total ft. wire								
13	1	1	20	30	GC CC	P	H	
	1	2	20	30	CC	F	N	
	1	3	20	20	GC	G	N	
	1	4	20	40	CC GC	G	H	
	2	1	20	50	RC CC	G	H	
	2	2	20	45	RC CC	F	N	
	2	3	20	45	CC RC	G	N	
	2	4	20	10	RC	G	H	
	3	1	30	55	RC GC	G	N	FO-1
	3	2	30	40	GC CC	P	N	
	3	3	30	10	CC	G	H	
	3	4	30	20	GC CC	G	N	
	4	1	20	25	RC GC	F	N	
	4	2	20	20	CC	G	N	
	4	3	20	65	CC GC	G	N	
	4	4	20	10	GC	F	H	
	5	1	20	35	RC CC	F	H	
	5	2	20	--				
	5	3	20	15	RC	G	H	
	5	4	20	15	RC	G	H	
	6	1	20	30	RC	G	N	
	6	2	20	6	CC	G	H	
	6	3	20	40	RC GC	G	H	
	6	4	20	12	CC	G	H	
	7	1	20	30	GC CC	G	N	
	7	2	20	30	CC RC	G	H	
	7	3	20	5	GC	F	H	
	7	4	20	10	GC	F	H	
	8	1	20	10	RC	G	H	
	8	2	20	25	GC RC	G	H	
	8	3	20	--				
	8	4	20	55	RC VC	G	H	
	9	1	20	50	GC RC	G	H	
	9	2	20	60	GC CC	G	N	
	9	3	20	--				
	9	3	20	--				
	10	1	20	--				
	10	2	20	45	GC RC	G	H	
	10	3	20	30	GC RC	G	H	
	10	4	20	30	GC RC	G	H	

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks	
13	11	1	20	30	GC CC	G	N		
	11	2	20	15	GC	G	H		
	11	3	20	20	RC CC	G	H		
	11	4	20	40	GC RC	G	H		
	12	1	30	--					
	12	2	30	35	GC RC	G	H	FO-1	
	12	3	30	25	GC VC	G	H		
	12	4	30	80	RC VC	G	H		
	13	1	20	60	CC GC	G	H		
	13	2	20	20	RC CC	G	H		
	13	3	20	30	GC	G	N		
	13	4	20	65	GC RC	G	N		
	14		20	<u>Empty</u>					
	1468 Total ft. wire								
14	1	1	20	--					
	1	2	20	10	RC	G	H		
	1	3	20	40	CC GC	G	N		
	1	4	20	65	RC	G	H		
	2	1	20	60	GC CC	G	H		
	2	2	20	8	GC	G	H		
	2	3	20	35	RC GC	G	H		
	2	4	20	45	CC GC	G	H		
	3	1	20	20	RC CC	G	H		
	3	2	20	20	RC	G	H		
	3	3	20	--					
	3	4	20	10	CC	G	H		
	4	1	20	40	GC CC	G	N		
	4	2	20	30	GC	G	N		
	4	3	20	10	GC	G	N		
	4	4	20	--					
	5	1	20	6	GC	G	H		
	5	2	20	15	CC	P	N		
	5	3	20	15	CC	G	H		
	5	4	20	35	GC CC	G	H		
	6	1	30	40	RC	G	N	FO-1	
	6	2	30	30	GC CC	G	N		
	6	3	30	20	GC CC	G	H		
	6	4	30	30	GC CC	G	H		
	7	1	20	35	RC RC	G	H		
	7	2	20	40	CC GC	F	H		
	7	3	20	30	CC RC	G	H		
	7	4	20	35	CC CC	F	H		

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks	
14	8	1	20	--					
	8	2	20	35	CC RC	G	N		
	8	3	20	20	RC CC	G	H		
	8	4	20	35	RC GC	G	H		
	9	1	20	40	GC RC	G	N		
	9	2	20	20	RC	G	H		
	9	3	20	30	RC	G	N		
	9	4	20	60	RC CC	G	N		
	10	1	20	40	GC CC	G	H		
	10	2	20	50	GC RC	G	H		
	10	3	20	30	CC	G	H		
	10	4	20	60	VC GC	G	H		
	11	1	20	75	RC GC	G	N		
	11	2	20	50	CC GC	G	H		
	11	3	20	10	RC	G	H		
	11	4	20	50	CC RC	G	N		
	12	1	20	55	RC CC	G	N		
	12	2	20	50	GC RC	G	H		
	12	3	20	55	CC RC	G	H		
	12	4	20	45	GC RC	G	N		
	13	1	20	50	CC RC	G	N		
	13	2	20	50	CC RC	G	N		
	13	3	20	40	GC	F	N		
	13	4	20	20	CC	G	H		
	14		20	Empty					
				1694 Total ft. wire					
	15	1	1	20	35	GC RC	G	N	
		1	2	20	30	GC CC	F	H	
		1	3	20	35	GC CC	F	H	
		1	4	20	30	GC CC	G	H	
		2	1	20	40	GC CC	G	N	
		2	2	20	50	GC RC	G	H	
2		3	20	15	CC	F	N		
2		4	20	15	GC	G	H		
3		1	20	15	GC	G	H		
3		2	20	50	RC CC	G	N		
3		3	20	--					
3		4	20	25	GC CC	F	H		
4		1	20	8	RC	P	H		
4		2	20	30	GC RC	G	H		
4		3	20	40	RC GC	G	H		
4		4	20	80	RC CC	G	H		

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks
15	5	1	20	15	CC	G	H	FO-1
	5	2	20	35	RC GC	G	H	
	5	3	20	45	CC GC	P	H	
	5	4	20	75	RC VC	G	H	
	6	1	20	15	GC	G	H	
	6	2	20	30	RC CC	P	H	
	6	3	20	40	CC	G	N	
	6	4	20	15	VC	G	H	
	7	1	20	40	CC	G	N	
	7	2	20	20	RC CC	F	H	
	7	3	20	110	VC GC	G	H	
	7	4	20	25	VC RC	G	N	
	8	1	30	30	CC RC	G	N	FO-1
	8	2	30	--				
	8	3	30	15	CC	G	H	
	8	4	30	20	CC	G	N	
	9	1	20	6	RC	G	H	
	9	2	20	25	CC RC	G	H	
	9	3	20	45	RC CC	G	N	
	9	4	20	--				
	10	1	20	15	CC	G	H	
	10	2	20	10	CC	G	H	
	10	3	20	50	RC CC	G	N	
	10	4	20	50	CC GC	G	H	
	11	1	20	10	CC	G	N	
	11	2	20	45	GC	G	H	
	11	3	20	75	CC RC	G	S	
	11	4	20	15	CC	G	H	
	12	1	20	15	CC	G	H	FO-2
	12	2	20	30	RC VC	G	N	
	12	3	20	55	RC CC	G	N	
	12	4	20	--				
	13	1	20	15	RC	G	N	
	13	2	20	--				
	13	3	20	15	RC	G	H	
	13	4	20	10	RC	G	N	
	14		20	--				
1514 Total ft. wire								
16	1	1	30	60	CC RC	G	N	FO-1
	1	2	30	10	GC	G	H	
	1	3	30	35	CC RC	G	H	
	1	4	30	30	RC	G	H	

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks
16	2	1	20	12	RC	G	H	
	2	2	20	65	RC GC	G	N	
	2	3	20	10	CC	G	H	
	2	4	20	30	RC GC	G	H	
	3	1	20	60	RC CC	G	S	
	3	2	20	30	RC	G	H	
	3	3	20	35	GC CC	F	N	
	3	4	20	20	GC	G	H	
	4	1	20	30	RC CC	G	H	
	4	2	20	60	GC CC	F	N	
	4	3	20	--				
	4	4	20	75	RC CC	G	N	
	5	1	20	55	GC RC	F	N	
	5	2	20	15	CC	G	H	
	5	3	20	30	RC CC	G	H	
	5	4	20	30	RC CC	G	H	
	6	1	20	90	VC	G	H	
	6	2	20	30	GC RC	G	H	
	6	3	20	20	RC	G	H	
	6	4	20	70	CC GC	F	N	
	7	1	20	55	RC GC	G	N	
	7	2	20	10	GC	G	H	
	7	3	20	40	GC CC	F	H	
	7	4	20	--				
	8	1	30	25	CC	G	H	FO-1
	8	2	30	40	RC CC	G	N	
	8	3	30	65	RC CC	G	H	
	8	4	30	50	RC CC	G	N	
	9	1	30	60	RC CC	G	N	FO-2
	9	2	30	60	RC CC	G	N	
	9	3	30	40	CC	G	N	
	9	4	30	80	RC CC	G	H	
	10	1	30	35	CC CC	F	I	FO-1
	10	2	30	25	GC	G	N	
	10	3	30	55	CC GC	G	N	
	10	4	30	30	VC GC	G	H	
	11	1	20	90	CC RC	G	N	
	11	2	20	35	CC	G	N	
	11	3	20	45	RC GC	G	N	
	11	4	20	75	GC RC	G	N	
	12	1	20	35	RC CC	G	N	
	12	2	20	15	RC	F	H	
	12	3	20	65	CC RC	F	N	
	12	4	20	50	RC CC	G	H	

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks
16	13	1	20	25	GC	G	N	
	13	2	20	60	CC RC	G	H	
	13	3	20	100	GC RC	G	N	
	13	4	20	10	RC	G	H	
	14							
				2177	Total ft. wire			
17	1	1	20	35	RC	G	H	
	1	2	20	35	RC	G	H	
	1	3	20	15	RC	G	H	
	1	4	20	50	GC RC	G	N	
	2	1	30	40	GC CC	P	N	FC-1
	2	2	30	40	CC RC	G	H	
	2	3	30	50	CC GC	P	N	
	2	4	30	25	GC RC	G	H	
	3	1	20	20	RC	G	H	
	3	2	20	20	RC CC	G	N	
	3	3	20	40	GC RC	G	N	
	3	4	20	35	CC RC	G	N	
	4	1	20	50	RC GC	G	S	
	4	2	20	40	GC RC	G	N	
	4	3	20	10	RC	G	N	
	4	4	20	75	VC CC	P	N	
	5	1	20	30	GC	G	H	
	5	2	20	15	GC	G	H	
	5	3	20	60	RC GC	G	H	
	5	4	20	10	CC	G	H	
	6	1	20	25	CC VC	G	H	
	6	2	20	15	GC	G	H	
	6	3	20	20	CC	G	H	
	6	4	20	--				
	7	1	20	30	CC RC	G	H	
	7	2	20	35	GC	G	N	
	7	3	20	--				
	7	4	20	--				
	8	1	20	30	RC	G	H	
	8	2	--20	--				
	8	3	20	50	CC RC	G	N	
	8	4	20	65	RC GC	G	H	
	9	1	20	--				
	9	2	20	25	RC CC	G	N	
	9	3	20	30	RC	G	H	
	9	4	20	40	GC CC	G	N	

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks	
17	10	1	30	35	GC RC	G	H	FO-2	
	10	2	30	40	RC CC	P	N		
	10	3	30	40	CC RC	G	N		
	10	4	30	30	RC CC	G	N		
	11	1	30	45	RC CC	G	H	FO-1	
	11	2	30	--					
	11	3	30	--					
	11	4	30	40	RC CC	G	H		
	12	1	20	20	RC GC	G	N		
	12	2	20	40	GC CC	G	N		
	12	3	20	50	CC	G	N		
	12	4	20	35	RC GC	G	H		
	13	1	20	60	RC GC	G	N		
	13	2	20	10	CC	G	H		
	13	3	20	40	RC GC	G	H		
	13	4	20	20	CC	G	H		
	14		20	<u>Empty</u>					
	1565 Total ft. wire								
	18	1	1	20	35	GC CC	G	N	
		1	2	20	25	CC	G	N	
		1	3	20	20	CC RC	G	H	
		1	4	20	70	GC CC	G	N	
		2	1	20	15	CC	G	N	
		2	2	20	25	CC RC	G	H	
2		3	20	--					
2		4	20	10	GC	F	H		
3		1	20	10	CC	P	H		
3		2	20	30	RC	G	N		
3		3	20	12	GC	G	H		
3		4	20	20	RC RC	F	S		
4		1	20	--					
4		2	20	30	RC	G	H		
4		3	20	25	GC RC	G	H		
4		4	20	--					
5		1	30	--				FO-5	
5		2	30	20	CC	G	N		
5		3	30	40	RC GC	G	N		
5		4	30	12	GC	G	H		
6		1	20	25	CC RC	G	H		
6		2	20	40	GC RC	G	H		
6		3	20	70	RC GC	G	N		
6		4	20	60	GC RC	G	N		

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks	
18	7	1	30	30	GC RC	G	H	FO-2	
	7	2	30	45	CC RC	G	H		
	7	3	30	20	GC	G	H		
	7	4	30	60	CC RC	G	H		
	8	1	20	10	RC	G	H		
	8	2	20	25	CC	G	N		
	8	3	20	30	RC CC	G	H		
	8	4	20	35	RC CC	G	N		
	9	1	30	75	CC RC	G	N	FO-2	
	9	2	30	60	GC RC	G	N		
	9	3	30	40	CC GC	G	H		
	9	4	30	20	CC RC	F	H		
	10	1	30	35	GC CC	G	H	FO-1	
	10	2	30	15	RC GC	G	H		
	10	3	30	30	RC GC	G	N		
	10	4	30	40	RC CC	G	N		
	11	1	20	35	RC CC	F	H		
	11	2	20	35	GC CC	G	N		
	11	3	20	45	RC CC	G	N		
	11	4	20	15	RC	G	N		
	12	1	20	10	GC	G	H		
	12	2	20	50	RC GC	G	H		
	12	3	20	15	CC	G	H		
	12	4	20	--					
	13	1	20	20	GC	G	H		
	13	2	20	30	RC	G	H		
	13	3	20	40	VC RC	G	H		
	13	4	20	10	RC	G	H		
	14		20	<u>Empty</u>					
	1469 Total ft. wire								
19	1		20						
	2		20						
	3		20						
	4		30						
	5		20						
	6		20						
	7		20						
	8		20						
	9		20						
	10		20						
	11		20						
	12		20						
	13		20						
	14		20						
New arrivals No inspection made									

New arrivals
No inspection made

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks
20	1	1	20	20	GC	G	N	
	1	2	20	45	RC	G	H	
	1	3	20	45	GC	G	N	
	1	4	20	25	RC	G	H	
	2	1	20	40	RC	G	N	
	2	2	20	40	GC CC	G	H	
	2	3	20	5	CC	G	H	
	2	4	20	50	GC RC	G	N	
	3	1	20	40	RC CC	G	N	
	3	2	20	80	GC RC	P	N	
	3	3	20	60	RC CC	G	H	
	3	4	20	45	GC RC	G	H	
	4	1	20	15	RC	G	H	
	4	2	20	60	RC GC	G	H	
	4	3	20	25	RC	G	H	
	4	4	20	25	RC	G	H	
	5	1	20	35	CC GC	G	N	
	5	2	20	15	GC	G	N	
	5	3	20	60	RC GC	G	N	
	5	4	20	90	RC CC	G	HS	
	6	1	20	30	GC VC	G	H	
	6	2	20	50	RC CC	G	N	
	6	3	20	20	RC	G	N	
	6	4	20	80	CC GC	G	H	
	7	1	30	30	RC CC	G	N	FO-1
	7	2	30	15	RC	G	H	
	7	3	30	50	GC RC	G	N	
	7	4	30	50	CC RC	G		
	8	1	20	10	RC	G	H	
	8	2	20	40	GC RC	G	H	
	8	3	20	60	RC GC	G	H	
	8	4	20	15	RC	G	H	
	9	1	30	--				
	9	2	30	30	CC RC	G	H	FO-1
	9	3	30	30	RC CC	G	HS	
	9	4	30	--				
	10	1	20	35	RC CC	G	N	
	10	2	20	--				
	10	3	20	40	GC CC	G	H	
	10	4	20	25	RC CC	G	H	
	11	1	25	--				FO-1
	11	2	25	35	GC	G	N	
	11	3	25	30	RC	G	H	
	11	4	25	20	CC	G	N	

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks	
20	12	1	30	20	RC GC	G	H	FO-1	
	12	2	30	10	GC	G	H		
	12	3	30	15	GC CC	G	H		
	12	4	30	70	RC	G	S		
	13	1		--					
	13	2		25	GC	G	H		
	13	3		--					
	13	4		--					
	14		20	<u>Empty</u>					
	1655 Total ft. wire								
	21	1	1	20	55	RC CC	G	N	
		1	2	20	60	GC CC	G	H	
		1	3	20	15	RC	G	H	
		1	4	20	--				
2		1	20	10	CC	G	H		
2		2	20	40	RC GC	G	N		
2		3	20	25	RC CC	G	N		
2		4	20	80	CC RC	G	N		
3		1	20	--					
3		2	20	10	GC	G	H		
3		3	20	55	CC CC	P	N		
3		4	20	80	RC CC	P	N		
4		1	30	50	CC	G	N	FO-1	
4		2	30	40	CC	G	N		
4		3	30	50	GC CC	G	H		
4		4	30	--					
5		1	20	35	GC VC	G	H		
5		2	20	20	GC	G	H		
5		3	20	10	CC	G	N		
5		4	20	--					
6		1	20	10	RC	G	H		
6		2	20	25	RC GC	G	H		
6		3	20	10	CC	G	H		
6		4	20	55	CC GC	G	H		
7		1	20	25	CC CC	P	H		
7		2	20	30	VC CC	G	H		
7		3	20	20	CC GC	G	H		
7		4	20	60	RC GC	F	N		
8		1	20	40	RC CC	G	H		
8		2	20	10	GC	G	H		
8		3	20	6	GC	G	N		
8		4	20	50	RC	G	N		

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks
21	9	1	20	30	RC CC	P	HS	FO-1
	9	2	20	25	CC RC	G	H	
	9	3	20	30	RC CC	G	H	
	9	4	20	20	GC	G	H	
	10	1	20	25	CC	G	H	
	10	2	20	60	GC	G	H	
	10	3	20	20	VC CC	G	H	
	10	4	20	--				
	11	1	20	20	GC	G	H	
	11	2	20	50	RC GC	G	H	
	11	3	20	40	CC	G	H	
	11	4	20	--				
	12	1	20	--				
	12	2	20	10	GC	G	H	
	12	3	20	55	GC RC	G	N	
	12	4	20	20	CC	G	N	
	13	1	20	40	RC	G	H	
	13	2	20	25	GC RC	G	H	
	13	3	20	20	CC CC	P	H	
	13	4	20	20	CC	G	H	
	14		20	<u>Empty</u>				
				1486 Total ft. wire				
22	1	1	20	20	GC	G	H	
	1	2	20	20	CC RC	G	H	
	1	3	20	20	CC	F	N	
	1	4	20	--				
	2	1	30	40	CC RC	G	H	
	2	2	30	20	CC	G	H	
	2	3	30	45	CC GC	G	H	
	2	4	30	35	RC	G	N	
	3	1	30	55	CC RC	G	N	
	3	2	30	30	RC	G	H	
	3	3	30	60	RC	G	N	
	3	4	30	40	RC CC	G	N	
	4	1	20	40	CC GC	G	N	
	4	2	20	20	CC	G	N	
	4	3	20	15	GC RC	G	N	
	4	4	20	50	RC VC	G	N	
	5	1	30	35	GC	G	H	FO-1
	5	2	30	15	CC	G	N	
	5	3	30	30	CC GC	G	H	
	5	4	30	20	CC CC	P	H	
	6	1	20	20	GC	G	N	
	6	2	20	30	RC	G	N	
	6	3	20	10	CC	G	N	
	6	4	20	--				

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition wof cord	How wired	Remarks
22	7	1	20	15	RC	G	H	
	7	2	20	35	GC	G	N	
	7	v 3	20	40	GC CC	G	H	
	7	4	20	45	GC RC	G	N	
	8	1	30	--				FO-2
	8	2	30	40	RC CC	G	H	
	8	3	30	30	CC RC	G	H	
	8	4	30	70	CC RC	G	H	
	9	1	20	35	RC CC	G	N	
	9	2	20	30	CC RC	G	H	
	9	3	20	45	GC CC	G	H	
	9	4	20	20	CC RC	G	H	
	10	1	30	20	RC CC	G	N	FO-1
	10	2	30	10	CC	G	H	
	10	3	30	20	RC	G	N	
	10	4	30	35	RC GC	G	N	
	11	1	20	10	GC	G	N	
	11	2	20	--				
	11	3	20	30	CC	G	H	
	11	4	20	15	RC	P	N	
	12	1	20	55	RC GC	G	N	
	12	2	20	45	CC RC	G	N	
	12	3	20	45	CC RC	G	N	
	12	4	20	40	CC RC	G	H	
	13	1	20	10	RC	G	H	
	13	2	20	20	CC RC	G	H	
	13	3	20	20	RC	G	N	
	13	4	20	20	RC	G	N	
	14		20	<u>Empty</u>				
				1470 Total ft. wire				
23	1	1	20	--				
	1	2	20	20	RC	G	N	
	1	3	20	30	RC	G	H	
	1	4	20	35	RC	G	N	
	2	1	20	20	RC CC	G	N	
	2	2	20	10	VC	G	H	
	2	3	20	35	GC RC	G	N	
	2	4	20	20	RC	G	N	
	3	1	20	30	RC	G	N	
	3	2	20	50	CC RC	P	H	
	3	3	20	20	RC	G	N	
	3	4	20	50	GC RC	G	H	

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks
23	4	1	30	20	RC	G	H	FO-1
	4	2	30	55	RC CC	G	N	
	4	3	30	25	RC CC	G	H	
	4	4	30	25	RC	G	H	
	5	1	30	40	RC CC	G	H	FO-1
	5	2	30	50	CC RC	G	H	
	5	3	30	65	VC CC	F	H	
	5	4	30	--				
	6	1	20	30	GC	G	H	
	6	2	20	50	RC CC	P	H	
	6	3	20	30	GC RC	G	H	
	6	4	20	50	RC CC	G	N	
	7	1	30	45	RC GC	G	H	FO-1
	7	2	30	60	RC VC	G	H	
	7	3	30	70	RC CC	F	H	
	7	4	30	10	CC	G	N	
	8	1	20	50	CC VC	G	H	FO-1
	8	2	20	25	GC	F	H	
	8	3	20	30	GC	G	H	
	8	4	20	25	RC	G	H	
	9	1	20	35	CC GC	G	N	
	9	2	20	85	CC CC	F	H	
	9	3	20	40	GC CC	G	N	
	9	4	20	40	CC RC	G	S	
	10	1	30	85	RC CC	G	N	FO-3
	10	2	30	45	GC CC	G	H	
	10	3	30	15	RC	G	N	
	10	4	30	40	RC	G	N	
	11	1	25	25	RC CC	G	H	FO-1
	11	2	25	40	VC GC	G	H	
	11	3	25	30	CC	G	N	
	11	4	25	50	RC GC	G	N	
	12	1	30	20	RC	G	H	FO-1
	12	2	30	20	GC CC	G	H	
	12	3	30	25	RC CC	G	H	
	12	4	30	40	GC VC	G	N	
	13	1	20	10	RC	G	H	
	13	2	20	25	GC	G	H	
	13	3	20	15	GC	G	N	
	13	4	20	50	GC CC	G	N	

14

Empty
1810 Total ft. wire



Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks
24	1	1	20	30	RC	G	N	
	1	2	20	--				
	1	3	20	20	GC	G	N	
	1	4	20	--				
	2	1	30	10	RC	G	H	FO-1
	2	2	30	50	RC GC	G	H	
	2	3	30	35	GC	G	N	
	2	4	30	10	CC	G	N	
	3	1	30	25	RC	G	H	FO-1
	3	2	30	10	RC	G	H	
	3	3	30	15	RC	G	H	
	3	4	30	40	CC CC	P	N	
	4	1	30	35	CC RC	G	H	FO-1
	4	2	30	20	GC	G	H	
	4	3	30	50	RC GC	G	S	
	4	4	30	25	RC GC	G	H	
	5	1	20	25	CC GC	G	H	
	5	2	20	45	RC CC	G	N	
	5	3	20	30	CC	G	H	
	5	4	20	--				
	6	1	30	50	GC CC	G	H	FO-3
	6	2	30	55	RC CC	G	N	
	6	3	30	60 CC	RC CC	G	H	
	6	4	30	10	CC	G	H	
	7	1	20	55	GC CC	G	H	
	7	2	20	--				
	7	3	20	--				
	7	4	20	25	RC CC	G	H	
	8	1	30	30	RC CC	G	H	FO-1
	8	2	30	20	GC RC	G	H	
	8	3	30	40	GC RC	G	N	
	8	4	30	--				
	9	1	25	50	CC VC	G	H	
	9	2	25	35	VC GC	G	N	
	9	3	25	50	RC GC	G	H	
	9	4	25	20	CC RC	G	N	
	10	1	30	20	CC	G	N	FO-2
	10	2	30	75	CC GC	P	N	
	10	3	30	65	RC CC	G	N	
	10	4	30	70	CC GC	G	N	
	11	1	30	50	RC CC	G	H	FO-1
	11	2	30	80	GC GC	G	H	
	11	3	30	40	GC RC	G	H	
	11	4	30	60	CC GC	G	H	

Block	Bldg.	Apt.	Fuse size	Length of cord	Type of cord	Condition of cord	How wired	Remarks
24	12	1	20	40	GC CC	G	N	
	12	2	20	55	VC CC	F	H	
	12	3	20	40	RC	G	H	
	12	4	20	30	RC GC	G	H	
	13	1	20	50	RC	G	H	FO-1
	13	2	20	50	VC RC	G	N	
	13	3	20	60	RC GC	G	H	
	13	4	20	35	GC RC	G	N	
14					<u>Empty</u>			







1775 Total ft. wire

"F" STREET

HEALTH CLINICS
SCALE 1/16" = 1'-0"

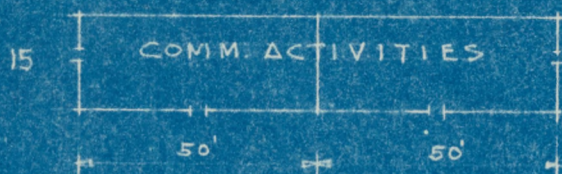





HEALTH CLINICS
(SEE DETAIL ABOVE)

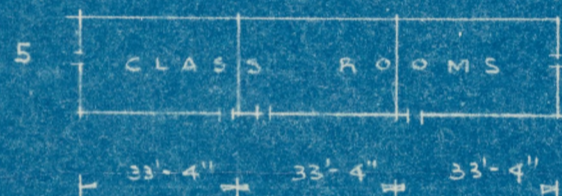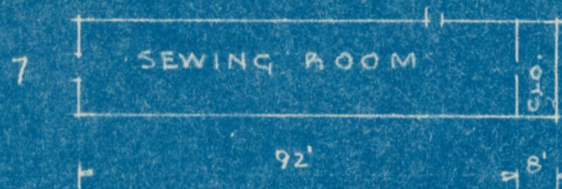

BLOCK
16



NOTE
SEE PAINT SCHEDULE

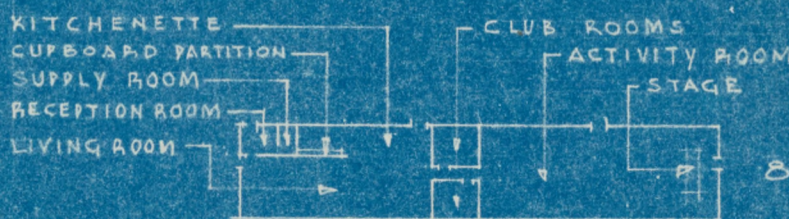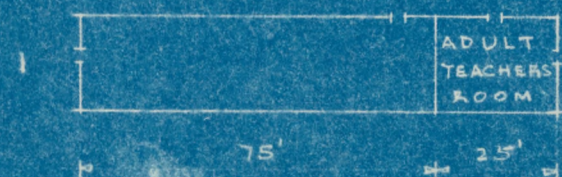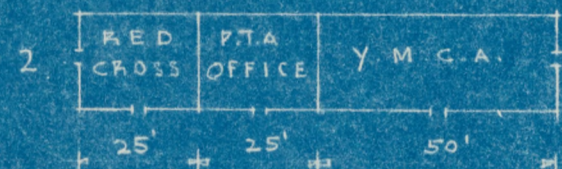

ADULT ENGLISH ACTIVITY HALL
SEE DETAIL DRAWING

4TH STREET

5TH STREET


"E" STREET

APP. SECTION HEAD	APP. PROJECT DIRECTOR
DIVISION CHIEF	SHEET 1 OF 1 SHEET
DATE: 4-22-48	MA-X 784


6/1/42

03.66


Building
Contractor
file

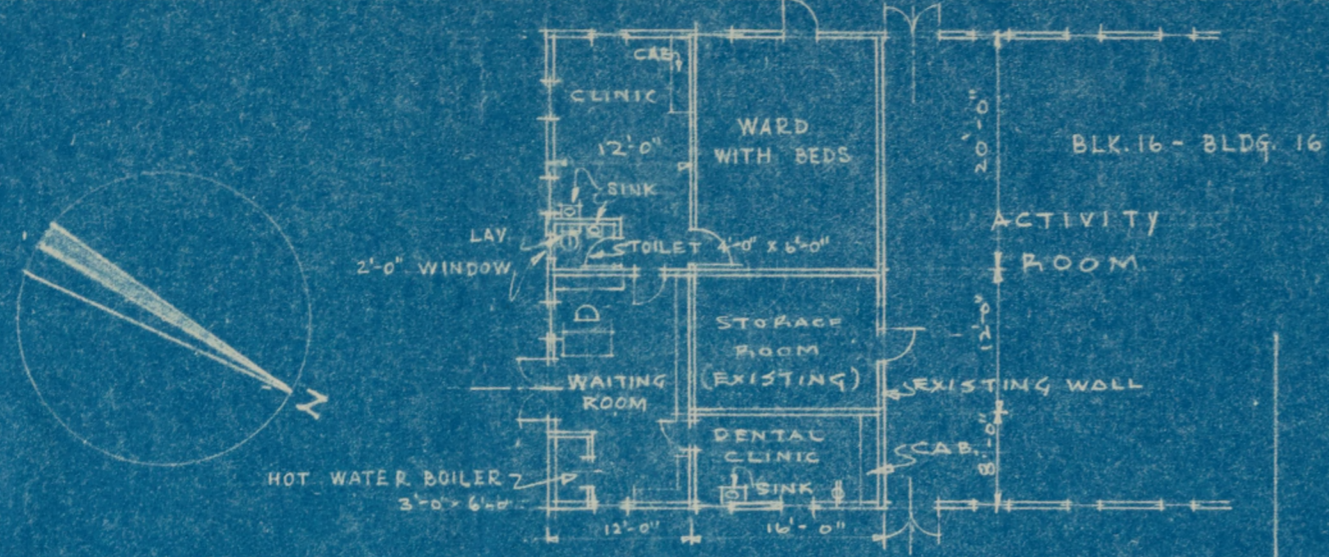

HEALTH CLINICS
SCALE 1/16" = 1'-0"

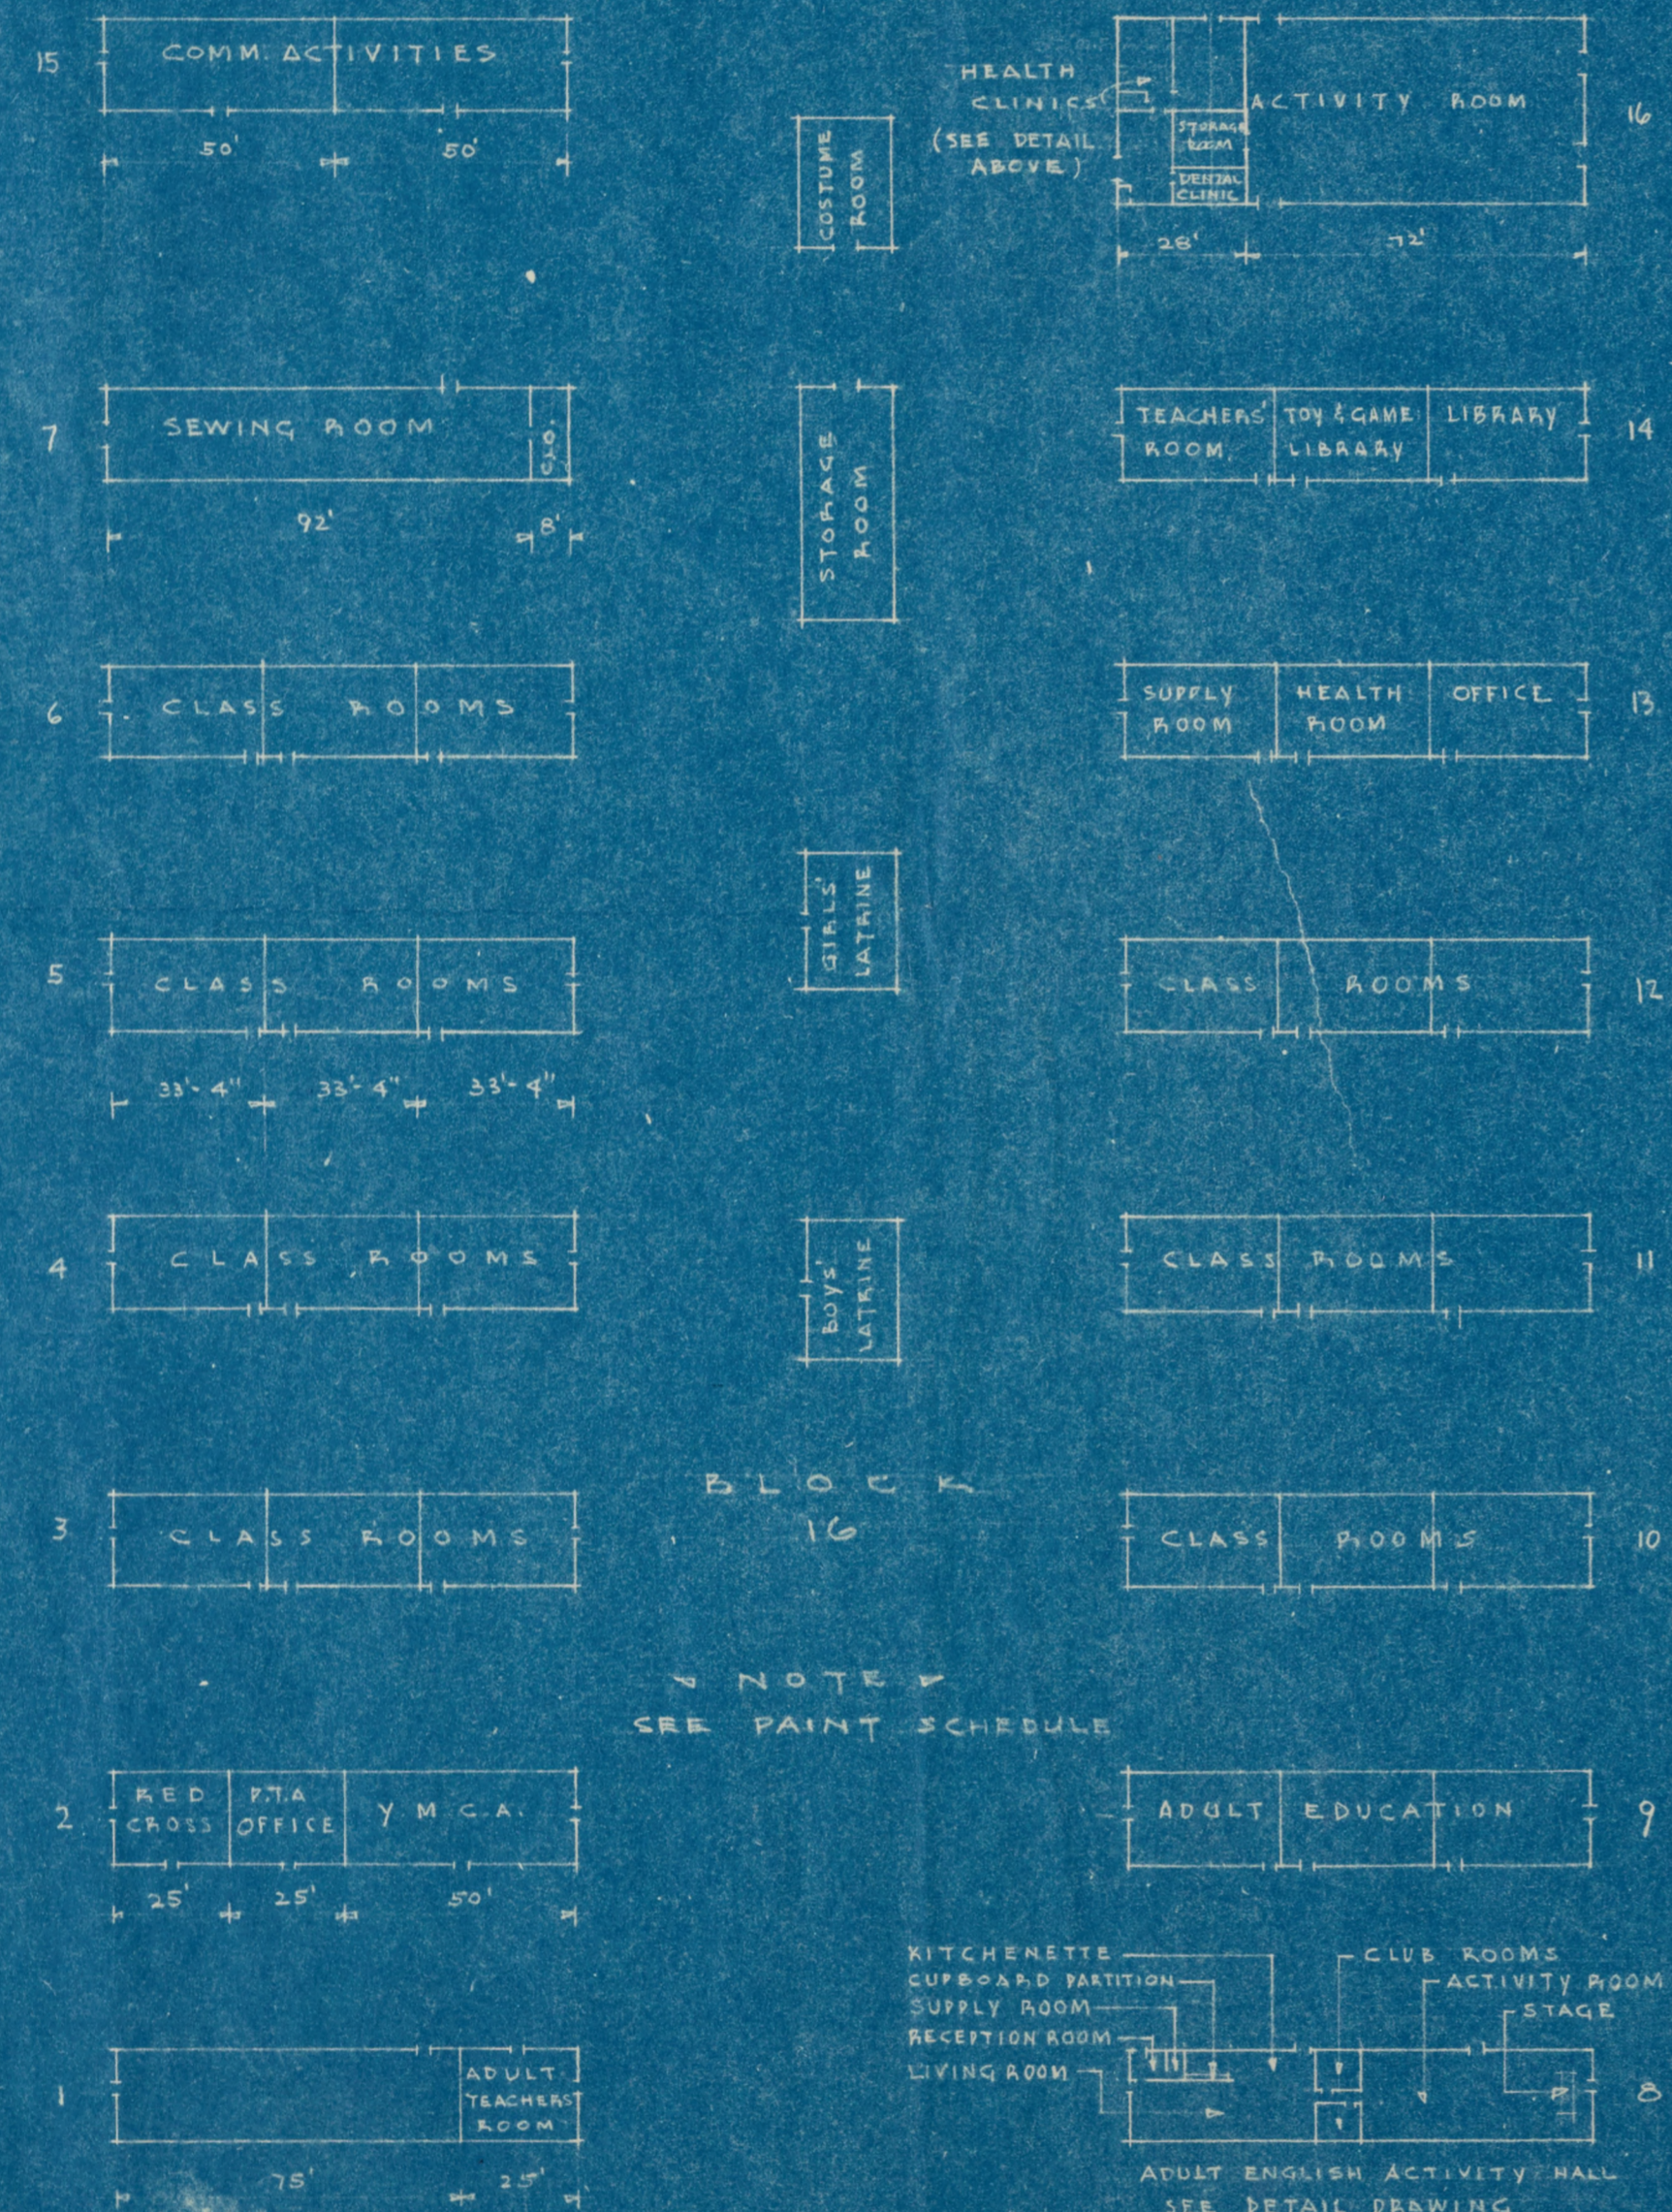

NOTE
SEE PAINT SCHEDULE

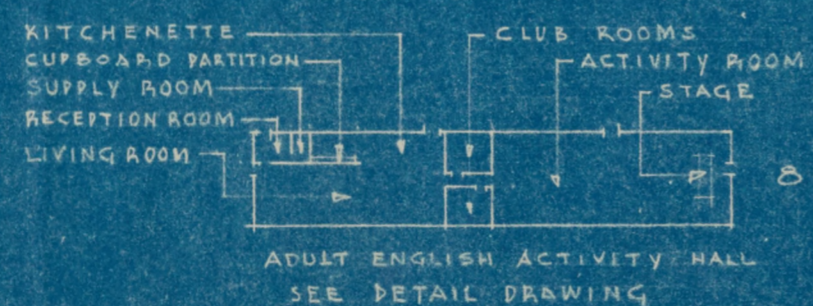


ADULT ENGLISH ACTIVITY HALL
SEE DETAIL DRAWING

COMMUNITY CENTER
BLOCK 16
SCALE 1" = 40'



TYPICAL CLASSROOM
SCALE 1/8" = 1'-0"

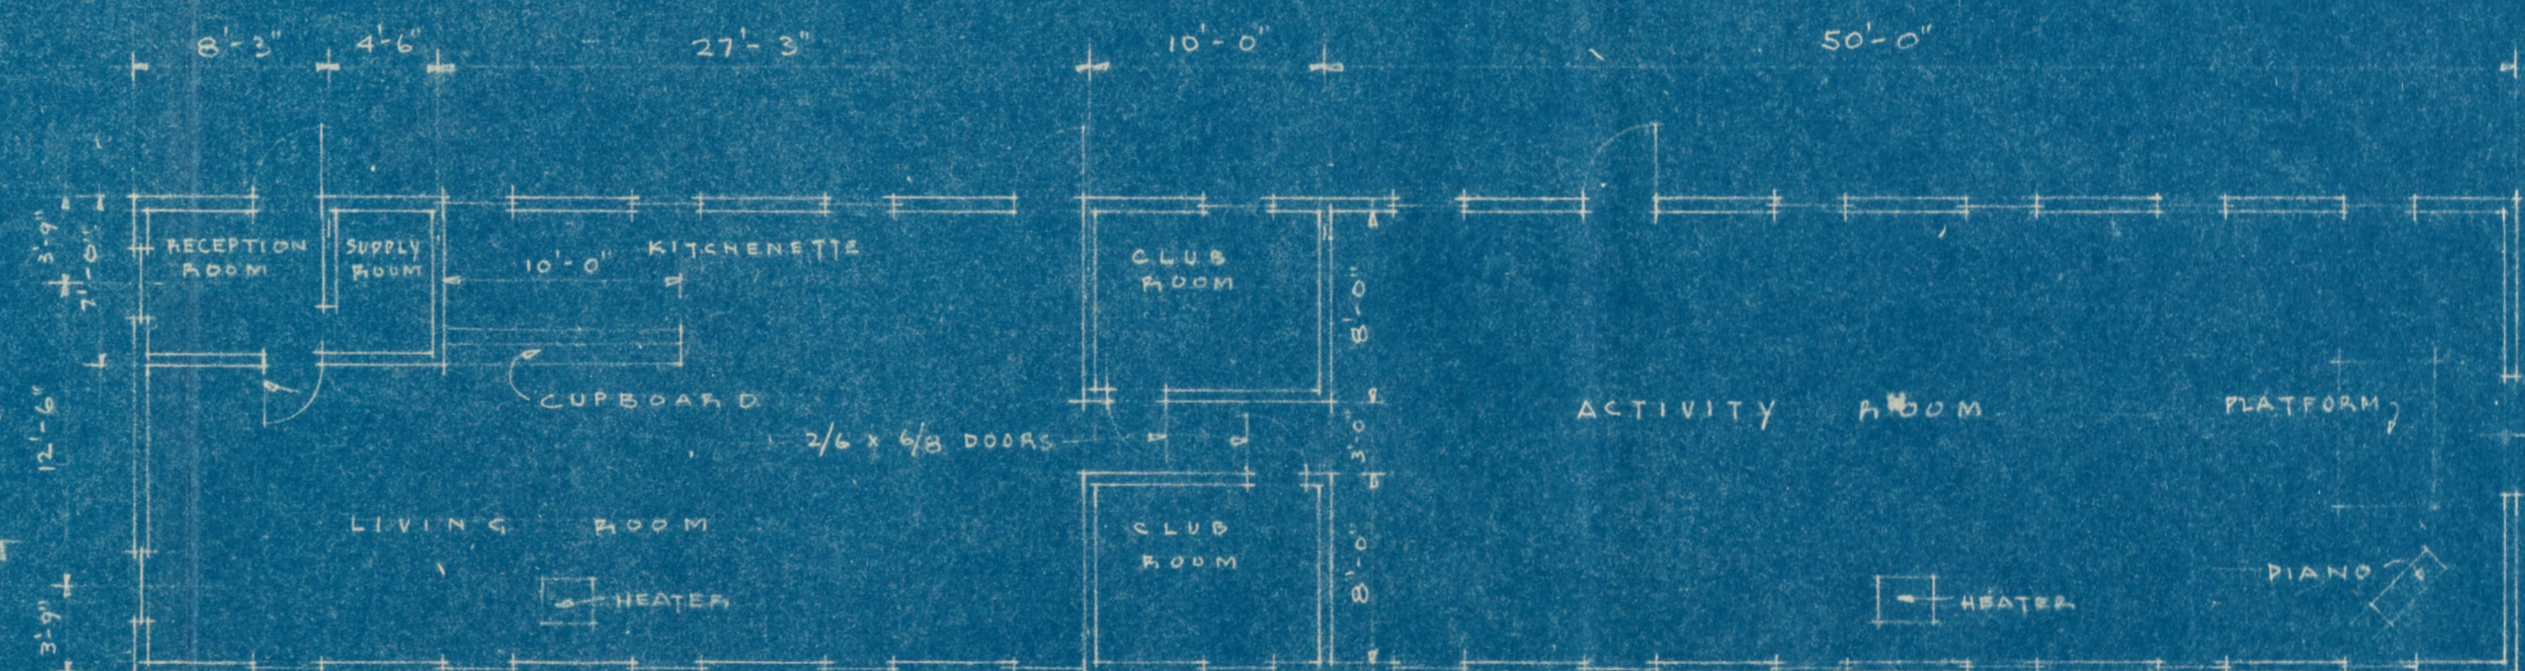

ADULT ENGLISH ACTIVITY HALL
BLOCK 16 BLDG. 8
SCALE 1/8" = 1'-0"

CUPBOARD DETAIL
SCALE 1/2" = 1'-0"

PAINT SCHEDULE	
BLDG. 1 PAINT TEACHER'S ROOM	BLUE
BLDG. 2, 8, 9	BLUE
BLDG. 3, 4, 5, 6, 7	IVORY
10, 11, 12	IVORY
BLDG. 15 & 14	GREEN
BLDG. 13 PAINT HEALTH & OFFICE	GREEN
MESS HALL (BLDG. 16)	BLUE

APP. *Clyde L. Simpson*
APP. *W. W. Adams*

COMMUNITY CENTER BLOCK 16			
WAR RELOCATION AUTHORITY DILLON S. MYER, DIRECTOR			
MANZANAR WAR RELOCATION PROJECT RALPH P. MEHRITT, PROJ. DIRECTOR			
APP. <i>W. W. Adams</i> DIVISION CHIEF	APP. <i>W. W. Adams</i> PROJ. DIRECTOR	SHEET NO. 1 OF 1 SHEETS	
DATE 4-12-44	MA - X	826	